



Infiltration of Ambient PM_{2.5} through Building Envelope in Apartment Housing Units in Korea

Dong Hee Choi¹, Dong Hwa Kang^{2*}

¹ Department of Architectural Engineering, College of Engineering, Kyungil University, Gyeongsbuk 38428, Korea

² Department of Architectural Engineering, College of Urban Sciences, University of Seoul, Seoul 02504, Korea

ABSTRACT

Air pollution due to PM_{2.5} is of public concern in Korea. Ambient PM_{2.5} can penetrate indoors through the building envelope, affecting the indoor PM_{2.5} concentrations. Most people stay indoors for approximately 80% of every day, implying that their primary exposure to PM_{2.5} could be determined by the indoor air. This study aims to investigate the infiltration of ambient PM_{2.5} through the building envelope in apartment housing units in Korea. The on-site infiltration test method, by using a blower-door depressurization procedure, was suggested in order to maintain an identical indoor-outdoor pressure difference among the tests. On-site experiments were conducted in 11 apartment housing units to estimate the PM_{2.5} infiltration factors. The results showed that the average infiltration factor of all the test housing units was 0.65 ± 0.13 (average \pm standard deviation), with a minimum of 0.38 and a maximum of 0.88. Furthermore, the results from the relation of the building airtightness data to the infiltration factors suggests that a leaky housing unit with high ACH₅₀, or a high specific effective leakage area (ELA), would be more significantly influenced by the ambient PM_{2.5}. The study demonstrated that the suggested infiltration test procedure was useful to assess the infiltration factors in conditions of controlled indoor-outdoor pressure differences in real housing units.

Keywords: PM_{2.5}; Infiltration; Building envelope; Apartment housing unit; Indoor air quality; Blower-door testing.

INTRODUCTION

Particulate matter (PM) pollution is considered a major threat, as it is associated with detrimental effects on human health and the quality of life (Stanek *et al.*, 2011; Henschel *et al.*, 2012; Van Erp AM *et al.*, 2012; WHO, 2013). Strong evidence points to the negative effects of short- and long-term exposure to PM on the respiratory and cardiovascular health of humans (Beelen *et al.*, 2008; Samoli *et al.*, 2008). In particular, particles with a diameter of less than 2.5 μm (PM_{2.5}) are of high concern because of their adverse effects on the respiratory system (Pope *et al.*, 2009). PM_{2.5} has been used commonly as one of indicators to describe PM. It has been shown that long-term exposure to PM_{2.5} is a strong risk factor for mortality (Pope *et al.*, 2002; Lepeule *et al.*, 2012; WHO, 2013). Air pollution due to PM_{2.5} in Korea is a matter of significant public concern. According to the Organization for Economic Cooperation and Development (OECD), the average annual concentration of the ambient PM_{2.5} levels in Korea is $29.1 \mu\text{g m}^{-3}$ (OECD, 2015), which is

the highest among the OECD countries, where the average level is $14.5 \mu\text{g m}^{-3}$, and is much higher than is the annual guideline limit of $10 \mu\text{g m}^{-3}$ set by the World Health Organization (WHO) (WHO, 2006). Ambient PM_{2.5} is known to be associated with industry, urbanization, and transport. This implies that the majority of the population in Korea is exposed to high levels of PM_{2.5}, and the attendant health risks, as a high percentage of people live in urban city areas. Moreover, the Asian dust event, called yellow dust, affects the Korean Peninsula during the winter and spring seasons (Kim and Park, 2001). Studies have indicated that increased PM_{2.5} concentrations were observed during such dust events (Kim and Kim, 2001; Stone *et al.*, 2011), exacerbating the already high levels of ambient PM_{2.5}.

In view of the growing concerns on ambient PM pollution, the Korea Environment Corporation, an affiliated agency under the Ministry of Environment, has since 2005 been providing real-time PM_{2.5} data online, along with the data on other air pollutants (PM₁₀, O₃, CO, SO₂, NO₂). The data on the concentrations of PM_{2.5} are collected from 317 sites in 97 areas across the country and are displayed hourly on the AirKorea website (KECO, 2016). AirKorea advises sensitive groups to stay indoors when the hourly average PM_{2.5} concentration exceeds $90 \mu\text{g m}^{-3}$ for over two hours. A warning is issued when the value exceeds $180 \mu\text{g m}^{-3}$ for over two hours, with every person prohibited from going

* Corresponding author.

Tel.: 82-2-6490-2766; Fax: 82-2-6490-2749

E-mail address: dhkang@uos.ac.kr

outdoors. However, most people stay indoors for about 90% of every day (Jenkins *et al.*, 1992; Robinson and Nelson, 1995; McCurdy *et al.*, 2000; Klepeis *et al.*, 2001; Schweizer *et al.*, 2007), which means that their primary exposure to PM_{2.5} could be determined by the indoor air. Moreover, children and the elderly, especially, probably spend most of their time indoors, particularly in a residential setting. Most of the residential units in Korea rely on natural ventilation, without any filtering system; therefore, closing the windows and doors could be the only solution to counteract the high ambient PM_{2.5} conditions. Nevertheless, ambient PM_{2.5} can penetrate indoors through the building envelope, affecting the indoor PM_{2.5} concentrations (Liu and Nazaroff, 2003).

Numerous studies have been conducted to show the effects of ambient PM_{2.5} on the indoor environment (Baek and Kim, 1997; Adgate *et al.*, 2002; Long and Sarnat, 2004; Cao *et al.*, 2005; Meng *et al.*, 2005). For quantification of the infiltration process through building leakage, three parameters have been used widely, i.e., the indoor/outdoor (I/O) ratio (Monn *et al.*, 1995; Abt *et al.*, 2000; Long and Sarnat, 2004; Lunden *et al.*, 2008), the infiltration factor (Lee *et al.*, 1997; Landis *et al.*, 2001; Wallace and William, 2005; Lazaridis *et al.*, 2006; Sarnat *et al.*, 2006; Hoek *et al.*, 2008; Meng *et al.*, 2009), and the penetration factor (Long *et al.*, 2001; Chao *et al.*, 2003; Thatcher *et al.*, 2003; Zhu *et al.*, 2005). The I/O ratio represents the relationship between the indoor and outdoor PM concentrations. The infiltration factor represents the equilibrium fraction of ambient PM that penetrates indoors and remains suspended in the indoor air. The penetration factor expresses the fraction of the particles in the infiltration air that passes through the building envelope. Although the penetration factor is the most relevant parameter for penetration through the envelope, the infiltration factor can be a useful parameter to analyze the total indoor PM_{2.5} entering from the outdoor environment (Chen and Zhao, 2011). In most previous studies, experiments have been conducted relevant to the infiltration factor in real buildings in natural air exchange conditions. However, differences in wind direction and speed at the time of measurements could cause variations in the indoor-outdoor pressure difference and the air exchange rate, which makes a direct comparison of buildings difficult. Moreover, the urban areas in Asian countries, where high concentrations of PM_{2.5} are of concern, have a high density of high-rise

residential buildings, with a wide range of indoor-outdoor pressure differences. Thus, it would be effective to derive the infiltration factor under controlled conditions of indoor-outdoor pressure difference.

The aim of this study was to investigate the infiltration of ambient PM_{2.5} through the building envelope, which affects the indoor air quality in the apartment housing units, by estimating the infiltration factors in controlled indoor-outdoor pressure differences. The on-site infiltration test method, using a blower-door depressurization procedure, was suggested to maintain an identical indoor-outdoor pressure difference among the tests in the different apartment housing units. In addition, the building airtightness was measured to determine the relation between the building airtightness and the infiltration factors.

EXPERIMENTAL METHOD

On-site experiments in 11 apartment housing units in Korea were conducted from December 2015 to April 2016 in order to investigate the infiltration of ambient PM_{2.5} through the building envelope, with the infiltration factors being used as a parameter of the ambient PM_{2.5} infiltration. To estimate the infiltration factors, a test method, using a blower-door depressurization technique, with an identical indoor-outdoor pressure difference of 10 Pa was proposed. The 10 Pa pressure difference was determined to reflect the normal pressure differences applicable to a building envelope (Kalamees *et al.*, 2010). Control of the indoor-outdoor pressure difference facilitates a direct comparison of the estimated infiltration factors among the test housing units. The building airtightness was also measured to obtain leakage information on the test units and to determine the correlation between their airtightness and infiltration factors. The blower-door airtightness test was conducted in compliance with ISO 9972 standard, estimating the air changes per hour at specified pressure, typically 50 Pa (ACH₅₀), and the effective leakage area (ELA) which are widely used airtightness index.

Description of Apartment Housing Units

Eleven unoccupied apartment housing units, located in three cities in Korea, were chosen as test units, as shown in Table 1. The age of the apartment buildings varied from 1

Table 1. Description of test housing units.

Housing unit code	Age (years)	Floor area (m ²)	Ceiling height (m)	Apartment housing unit type	City
A	10	85	2.3	Three bedroom	Daegu
B	19	212	2.3	Four bedroom	Daegu
C	37	57	2.15	Three bedroom	Seoul
D	34	36	2.3	Two Bedroom	Seoul
E	12	85	2.3	Three bedroom	Seoul
F	14	36	2.3	Two bedroom	Seoul
G	4	18	2.3	Studio	Seoul
H	20	50	2.3	Two bedroom	Chungju
I	6	20	2.15	Studio	Seoul
J	14	65	2.25	Three bedroom	Seoul
K	1	36	2.3	Two bedroom	Seoul

to 37 years. The types of housing unit ranged from a studio apartment to one- to four-bedroom apartments, and the floor area of the housing units varied from 18 m² to 212 m². In general, the north and/or south sides of the housing units were exposed to the outdoor air, and the junctions of the vertical walls and windows were assumed the main particle infiltration passages through the building envelope. The housing units feature different types of windows and window frames, i.e., single pane and double-strength sheet windows. There was no mechanical ventilation system in the units, except a local ventilation system, such as a kitchen hood and bathroom exhaust fan.

Envelope Airtightness Testing

Envelope airtightness was measured by using the typical blower-door fan depressurization/pressurization technique (Retrotec 3101 Blower Door System, Retrotec, USA). This technique measures the air flow through the building envelope leaks at indoor-outdoor pressure differences, which can be expressed by a power-law equation of flow through an orifice, as shown in Eq. (1).

$$Q_f = C \Delta P_f^n \tag{1}$$

where, Q is the air flow (m³ h⁻¹), ΔP is the pressure difference (Pa), C is the flow coefficient (m³ h⁻¹ Pa⁻ⁿ), n is the pressure exponent, and the subscript f relates to the fan-induced flow or pressure. The constants C and n are obtained by regression of the data derived from the blower-door testing.

The aim of the testing is to characterize the airtightness of the test units by estimating the ACH₅₀ and the ELA (ISO 9972, 2015). The specified pressure ACH₅₀ facilitates a comparison of the normalized airflow of the test units with a different volume induced by pressure of 50 Pa with the use of a fan. The absolute size of the leakage in the units is quantified by ELA, defined by Eq. (2).

$$ELA = C \cdot \Delta P_r^{n-1/2} \cdot \sqrt{\frac{\rho}{2}} \tag{2}$$

where ELA is the effective leakage area (m²), ΔP_r is the reference pressure, and ρ is the density of the air (kg m⁻³). The C and n values were determined from the blower-door testing results by fitting Eq. (1). The air flow through the building envelope leaks was measured relevant to five-

point indoor-outdoor pressure differences (10, 20, 30, 40, 50 Pa). The specific leakage area, defined by the ratio of the effective leakage area to the floor area of the unit, was used to compare the relative leakiness of units of different sizes.

As regards the envelope airtightness testing, the front entrance of each unit was selected as the doorway to install the blower-door system. Before each test, the exterior doors and windows were closed and locked, remaining shut during the test. All the interior doors were opened and the kitchen hood and bathroom exhaust fan were turned off and sealed. In addition, all other possible leakage pathways, i.e., wall outlets and bathroom drains were sealed.

Test Procedure for Infiltration Factors of PM_{2.5}

Fig. 1 shows the schematic diagram of the test procedure. Maintaining an identical indoor-outdoor pressure difference during the experiments could be achieved by using the blower-door depressurization procedure. Before the main infiltration test procedure, a blower door was installed at the front entrance of each test unit and, simultaneously, two identical PM_{2.5} concentration monitors (TSI AM 510, TSI, USA) were installed both indoors and outdoors. Both PM_{2.5} monitors were calibrated and certified by the manufacturer right before the experiments for the quality assurance of the measurements. A recent research (Yun *et al.*, 2015) demonstrated that the monitors require correction to measure the mass of particulates and suggested the correction factor of AM510 in Korean situation. In this study, to focus on the investigation of the infiltration factors by measuring ratios between indoor-outdoor particle concentrations, the correction of the monitors was not considered. The indoor PM_{2.5} sampling location was a table located in the center of every housing unit. Typically, Korean apartment housing units are equipped with a packaged air conditioner, with an outdoor condenser unit located on the vertical wall outside each unit. The outdoor PM_{2.5} monitor was placed on the outdoor condenser unit. Prior to the blower-door depressurization procedure, all the air pathways, including the kitchen hoods, bathroom exhausts, bathroom drains, and wall outlets were sealed. This sealing was done to ensure that only particle infiltration through the building envelope would be considered in the infiltration test.

The main infiltration test started after the preparations had been completed, with the blower door starting the depressurization (ΔP = 10 Pa) and the PM_{2.5} monitoring devices starting the data logging. The assumption was that the

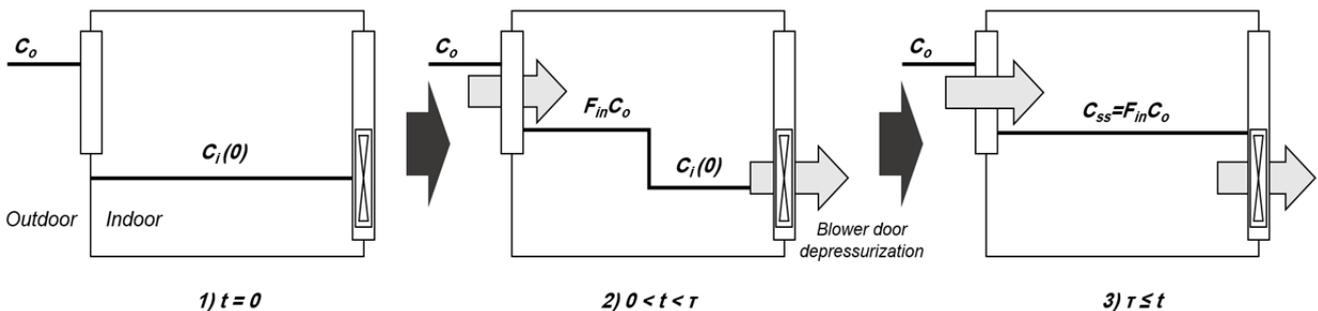


Fig. 1. Schematic diagram of the infiltration test procedure.

infiltrated outdoor air would completely replace the stagnant room air after one time constant. The depressurization was therefore continued for more than one time constant in the test housing units. The time constant was determined by the following Eq. (3).

$$\tau = 1/ACH_{10} \quad (3)$$

where, τ is the time constant (h), and ACH_{10} is the air exchange rate at an indoor-outdoor pressure difference of 10 Pa (h^{-1}). The ACH_{10} value was obtained by the airtightness test.

After one time constant, the indoor $PM_{2.5}$ concentration profile was assumed to have reached steady-state conditions. The blower-door depressurization and the $PM_{2.5}$ monitors remained operating for an additional 20 minutes to record the steady-state indoor and outdoor concentrations. Finally, the recorded $PM_{2.5}$ concentration data were collected for post data analysis to calculate the $PM_{2.5}$ infiltration factors.

The infiltration factors were calculated based on the assumption of the $PM_{2.5}$ mass balance in the housing unit. Assuming there was no indoor $PM_{2.5}$ generation or resuspension, the mass balance equation can be expressed as follows, by Eq. (4).

$$\frac{dC_i(t)}{dt} = P \cdot ACH_{10} \cdot C_o - (ACH_{10} + k) \cdot C_i(t) \quad (4)$$

where, t is the time (h), $C_i(t)$ is the indoor $PM_{2.5}$ concentration at time t , P is the penetration coefficient (-), C_o is the ambient $PM_{2.5}$ concentration, and k is the depositional rate (-).

Several assumptions were made for the infiltration calculation; 1) the ambient $PM_{2.5}$ concentration is constant during the test period, 2) the indoor air in the housing units is well-mixed, and 3) the indoor $PM_{2.5}$ concentration reached

equilibrium after one time constant. When the test time is greater than the time constant, it is implied that the indoor $PM_{2.5}$ concentration has reached a steady-state condition, then

$$\frac{dC_i(t)}{dt} = 0 \quad (5)$$

Therefore, Eq. (4) can be summarized as follows by Eq. (6).

$$C_i(t) = C_{i,ss} = \frac{P \cdot ACH_{10} \cdot C_{o,ss}}{ACH_{10} + k} \quad (6)$$

where, $C_{i,ss}$ is the steady-state indoor $PM_{2.5}$ concentration. Finally, the infiltration factor can be obtained from Eq. (7).

$$F_{in} = \frac{P \cdot ACH_{10}}{ACH_{10} + k} = \frac{C_{i,ss}}{C_{o,ss}} \quad (7)$$

where F_{in} is the infiltration factor (-).

RESULTS AND DISCUSSION

Ambient $PM_{2.5}$ Concentration

Fig. 2 shows the average and the standard deviation of the ambient $PM_{2.5}$ concentrations during the entire test period in each test housing unit. As each test was conducted separately, at different times and locations, there were significant differences in the $PM_{2.5}$ concentrations between the test units. The maximum ambient $PM_{2.5}$ concentration was $180 \mu g m^{-3}$ in housing unit H, whereas the minimum concentration was $38 \mu g m^{-3}$ in housing unit G. According to the AirKorea website, which provides real-time $PM_{2.5}$ concentration data

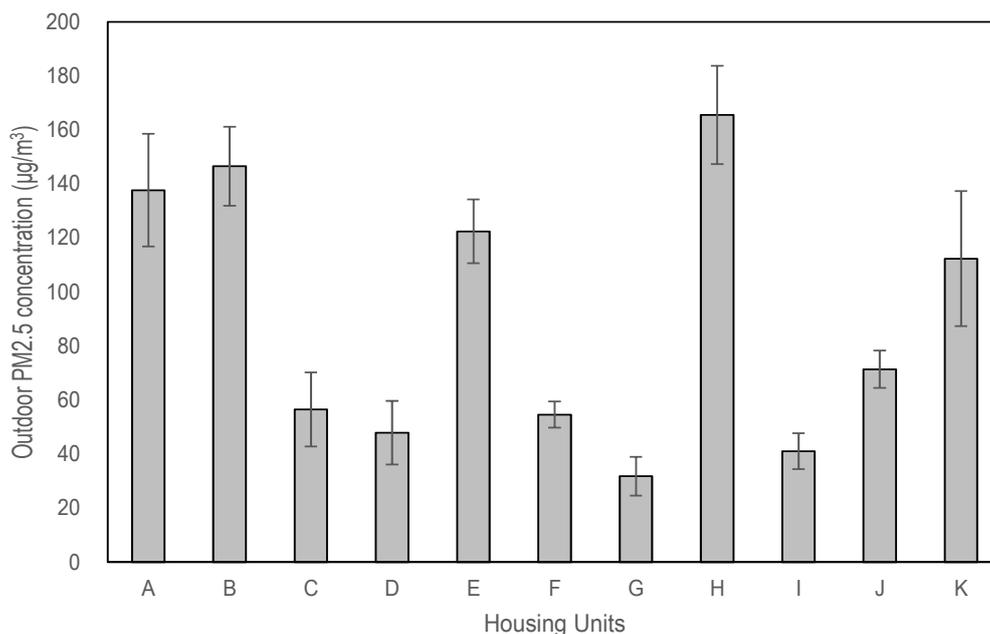


Fig. 2. Average and standard deviation of ambient $PM_{2.5}$ concentration on the day of testing for each unit.

online, the PM_{2.5} concentrations are classified into four categories; good (0–15 µg m⁻³), average (16–50 µg m⁻³), bad (51–100 µg m⁻³), and very bad (more than 100 µg m⁻³). According to this classification, the measurements indicated that five test housing units had very bad PM_{2.5} concentrations (Units A, B, E, H, and K), three had bad conditions (Units C, F, and J), three had average conditions (Units D, G, and I), with no good conditions being found in any of the housing units.

In all the units, the air quality standard of 35 µg m⁻³ for 24-hour PM_{2.5}, established by the United States Environmental Protection Agency (USEPA, 2012), was exceeded. Furthermore, the WHO standard of 10 µg m⁻³ for 24-hour PM_{2.5} was exceeded by a considerable margin (WHO, 2006). Considering that the duration of each test was about five hours, the average ambient PM_{2.5} concentrations presented here are approximately five-hour averaged concentration data. Although no precise direct comparison with the above standards could be made, it could be stated that the levels of the ambient PM_{2.5} concentrations at the time of measurement were relatively high. Compared with the other PM_{2.5} data obtained in Korea, the PM_{2.5} concentration measured in Gosan (Stone *et al.*, 2011) during the spring of 2007 showed similar levels, ranging from 28 to 122 µg m⁻³, with the 24-h average PM_{2.5} concentration being 36 ± 26 µg m⁻³. As could be expected, periods with no dust events showed lower levels, while periods with dust events presented higher levels, exceeding 100 µg m⁻³ (Stone *et al.*, 2011).

Airtightness Test Result

Table 2 shows the results of the airtightness tests on the housing units, including the ACH₅₀ and ELA. The estimated airtightness test results represent the information on leakage relevant to the exterior vertical walls and the windows of the housing units. The ACH₅₀ values of the housing units ranged from 1.44 h⁻¹ to 12.39 h⁻¹, which far exceeded the *Passivhaus* standard of 0.6 ACH₅₀ (PHI, 2007). Various units (Units A, B, E, G, and K) met the requirement of 5.0 ACH₅₀ set by Energy Star 3.0 (USEPA, 2013), while the rest of the units (Units C, D, F, H, I, and J) showed high levels, above 5.0 ACH₅₀. Except for Unit I, the buildings in the group of leaky housing units (Units C, D, F, H, and J) were older than 14 years. Generally, the results showed

that the older housing units had poor airtightness, resulting in high ACH₅₀ values.

The ELA of the housing units ranged from 8.44 cm² to 435.35 cm², generally showing a proportional relationship to the floor area. An exceptionally small ELA value of 8.44 cm² was indicated for Unit G. This is ascribed to Unit G being recently built, i.e., within a year prior to the tests, having an airtight window system, and being a studio apartment, with the smallest floor area of the all the units.

Usually, the flow exponent depends on the flow regime, namely, 0.5 for fully turbulent flow and 1.0 for laminar flow. In practice in many instances, flow exponent values of approximately 0.6 and 0.7 are found. Generally, in this study, the estimated flow exponent values were found to be within reasonable ranges.

Infiltration Factors of the Test Housing Units

Fig. 3 shows an example of the ambient and indoor PM_{2.5} concentration profile during the infiltration tests to demonstrate the data used to calculate the infiltration factors. The indoor and outdoor concentrations at a steady-state condition were averaged, then listed in Table 3 for all housing units. The infiltration factors were calculated by using the ratios of the steady-state ambient and indoor PM_{2.5} concentrations.

Fig. 4 shows the estimated PM_{2.5} infiltration factors relevant to 10 Pa of pressure difference. The average infiltration factor in all the test housing units was 0.65 ± 0.13 (average ± standard deviation), with a minimum of 0.38 to a maximum of 0.88. Table 3 lists the infiltration factors, as well as the outdoor air exchange rates and the average steady-state ambient PM_{2.5} concentrations of the housing units. Small standard deviation values were indicated for the infiltration factors and average ambient PM_{2.5} concentrations, indicating that the infiltration tests were conducted in sufficiently steady-state conditions.

In their research, Chen and Zhao (2011) reviewed 21 previous experimental studies on the relationship between indoor and outdoor particles, suggesting that the average infiltration factors for PM_{2.5} measured by the different researchers varied considerably between 0.3 and 0.82. The reported experimental data were obtained from homes in the USA or Europe. Compared with the values from previous research, the average infiltration factor of 0.65 measured in

Table 2. Airtightness test results of housing units.

Housing unit code	ACH ₅₀ (h ⁻¹)	Effective Leakage Area, ELA (cm ²)	C (m ³ h ⁻¹ Pa ⁻ⁿ)	n (-)
A	3.11	130.72	49.11	0.654
B	4.04	435.35	159.63	0.671
C	12.39	381.39	136.02	0.691
D	7.50	144.32	58.31	0.601
E	4.15	191.01	70.82	0.663
F	9.80	199.74	81.94	0.590
G	1.44	8.44	2.53	0.815
H	11.74	342.67	144.13	0.572
I	10.25	97.85	38.24	0.625
J	5.46	212.10	89.15	0.573
K	3.13	43.70	14.60	0.738

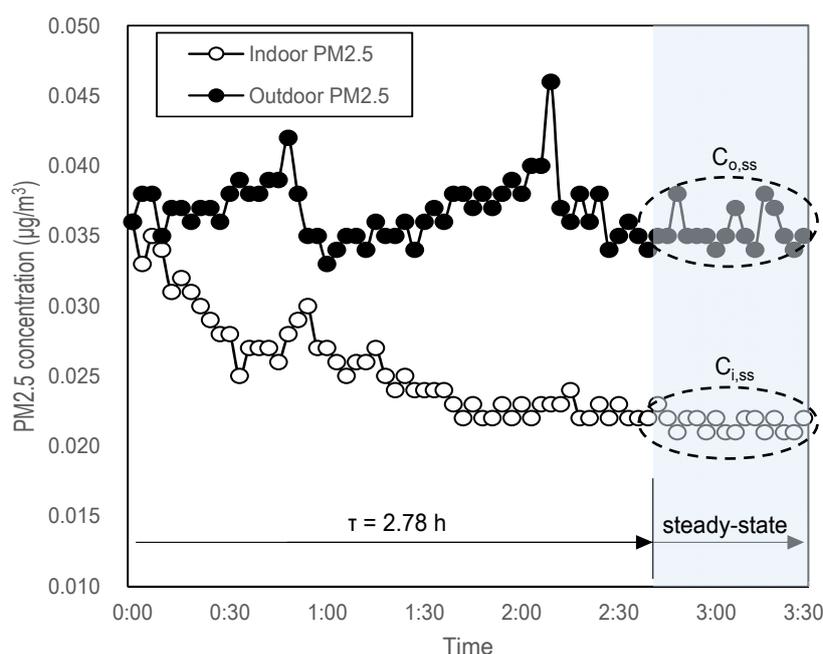


Fig. 3. An example of ambient and indoor PM_{2.5} concentration profile during the infiltration test (Unit G).

Table 3. Results of infiltration tests in test housing units.

Housing unit code	Outdoor air exchange rate, λ (h^{-1})	Indoor PM _{2.5} concentration at steady-state condition, $C_{i,ss}$ ($\mu\text{g m}^{-3}$)		Ambient PM _{2.5} concentration at steady-state condition, $C_{o,ss}$ ($\mu\text{g m}^{-3}$)		Infiltration factors, F_{in} (-)	
		Average	Standard deviation	Average	Standard deviation	Average	Standard deviation
A	1.13	61	0	160	12	0.38	0.03
B	1.45	107	1	168	6	0.64	0.02
C	5.30	56	2	78	2	0.72	0.03
D	2.82	25	0	34	2	0.75	0.04
E	1.00	79	2	134	2	0.59	0.02
F	3.75	38	1	53	1	0.72	0.03
G	0.36	21	1	36	2	0.60	0.03
H	4.89	135	1	192	2	0.71	0.01
I	3.98	31	1	35	2	0.88	0.06
J	2.24	46	1	70	2	0.66	0.02
K	0.98	70	1	131	2	0.53	0.01

the current study in Korea was high. The infiltration factor is a function of particle size, indoor-outdoor pressure difference, air exchange rate, geometry of leaks, and the depositional rate. It is assumed that the 10 Pa indoor-outdoor difference adopted in this study could have affected the level of the infiltration factor.

Fig. 5 shows the relationship between the infiltration factors and the airtightness test results. The ACH₅₀, effective leakage area and the specific effective leakage area were correlated with the infiltration factors. Power trend lines were drawn to illustrate the relationship to the measured data. Generally, although the R-square values were less than 0.5, the infiltration factors tended to increase with the ACH₅₀ values.

The results from data on the relationship between the building airtightness and the infiltration factors indicate

that a leaky housing unit, with high ACH₅₀ or high specific ELA, would be influenced more significantly by polluted ambient PM_{2.5}. At the present time, air-tight building construction practices are followed in Korea in the effort to reduce energy consumption in the building sector. The aim of this endeavor is to comply with the standards prescribed by international treaties, such as the Kyoto Protocol and the Paris Agreement (2015) for greenhouse gas reduction. This trend implies that the new build housing units are likely less influenced by ambient PM_{2.5} than are aged buildings with relatively leaking envelopes.

DISCUSSION

This study demonstrated that the infiltration test procedure employed was useful to assess the infiltration factors in

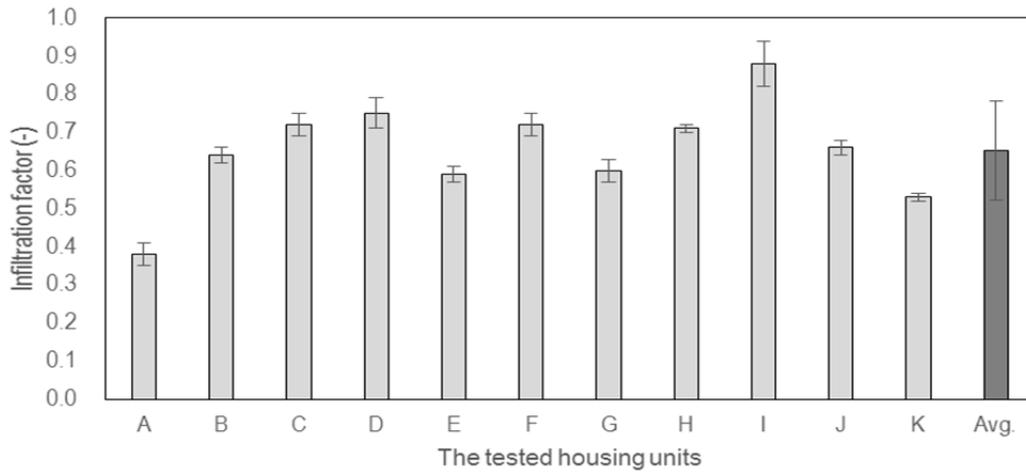


Fig. 4. PM_{2.5} infiltration factors in test housing units.

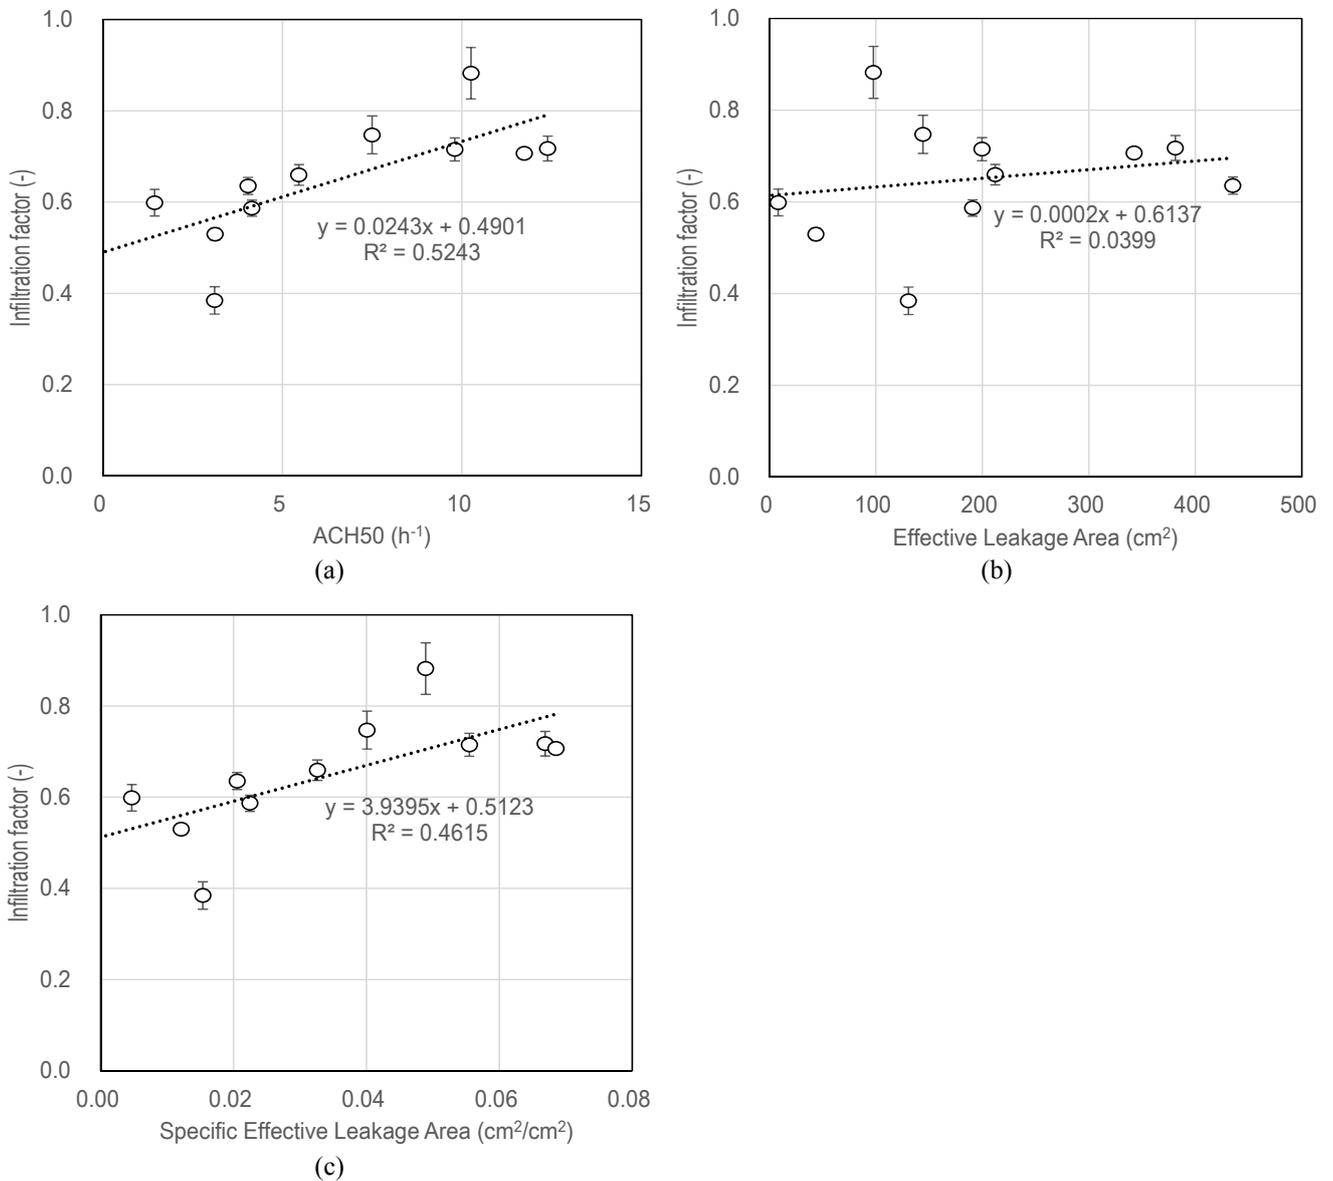


Fig. 5. Relationship of infiltration factors to airtightness test results: a) ACH₅₀; b) Effective leakage area (ELA); c) Specific effective leakage area (sELA).

conditions of controlled indoor-outdoor pressure difference in real housing units. The vertical distribution of pressure on the exterior wall of a high-rise multi-family house, similar to those often constructed in urban areas in Asian countries, would vary, depending on the wind pressure and stack effect. The suggested particle infiltration test method enabled direct comparison of the infiltration factors in all the test housing units, with the same pressure condition.

It should be noted that the infiltration factors were estimated in a pressure difference condition of 10 Pa between the indoor and the outdoor. Generally, it is known that the normal pressure difference applicable to a building envelope is 0 to 5 Pa. The slightly higher pressure difference in this study was intended to reduce the uncertainty of the infiltration tests. In numerous Asian cities, where high-rise residential buildings are abundant, the indoor-outdoor pressure difference would be larger than 5 Pa because of the wind and stack effect. Especially in winter, when the ambient PM_{2.5} shows high levels because of industrial/domestic heating and dust events, the stack effect, combined with the outdoor wind velocity, would increase the pressure difference. Therefore, the 10 Pa difference test condition used in this study could be meaningful to indicate the impact of ambient PM_{2.5} in indoor environments in such conditions. In real buildings, the direction of air flow and PM_{2.5} transport would vary depending on the pressure conditions applied to building envelope resulting in different I/O ratios and infiltration factors. Further investigation of the influence of various pressure differences is being planned in future research.

Additionally, apartment housing units with no mechanical ventilation systems were investigated in this study; however, mechanically ventilated housing units would have different infiltration characteristics. Since 2009 in Korea, new build or remodeled apartment complexes with more than 100 units have been adopting mechanical ventilation systems in an effort to meet the level of 0.5 ACH specified for indoor air quality (IAQ). The effect of ambient PM_{2.5} on the indoor environment in mechanically ventilated housing units should be examined in further study.

CONCLUSIONS

The current study investigated the infiltration of ambient PM_{2.5} through the building envelope in apartment housing units in Korea. The on-site infiltration test method, by using a blower-door depressurization procedure, was used in order to maintain identical indoor-outdoor pressure differences among all the tests. On-site experiments in 11 apartment housing units were conducted to estimate the PM_{2.5} infiltration factors. The results showed that the average infiltration factor of all the test housing units was 0.65 ± 0.13 (average \pm standard deviation), with a minimum of 0.38 to a maximum of 0.88. In addition, the results from the relationship between the building airtightness data and the infiltration factors indicated that a leaky housing unit, with high ACH50 or high specific ELA, would be significantly more influenced by ambient PM_{2.5}. This study demonstrated that the infiltration test procedure suggested in this study was useful to assess the infiltration factors, in controlled

indoor-outdoor pressure differences, in real housing units.

ACKNOWLEDGMENTS

This research was supported by Basic Science Research Program through the National Research Foundation of Korea (NRF) funded by the Ministry of Science, ICT & Future Planning (2014R1A1A3051924).

REFERENCES

- Abt, E., Suh, H.H., Catalano, P. and Koutrakis, P. (2000). Relative contribution of outdoor and indoor particle sources to indoor concentrations. *Environ. Sci. Technol.* 34: 3579–3587.
- Adgate, J.L., Ramachandran, G., Pratt, G.C., Waller, L.A. and Sexton, K. (2002). Spatial and temporal variability in outdoor, indoor, and personal PM_{2.5} exposure. *Atmos. Environ.* 36: 3255–3265.
- Baek, S.O. and Kim, Y.S. (1997). Indoor air quality in homes, offices and restaurants in Korean urban areas—indoor/outdoor relationships. *Atmos. Environ.* 31: 529–544.
- Beelen, R., Hoek, B., Brandt, P.A. van den, Goldbohm, R.A. and Fischer, P. (2008). Long-term effects of traffic-related air pollution on mortality in a Dutch cohort (NLCS-AIR study). *Environ. Health Perspect.* 116: 196–202.
- Cao, J.J., Lee, S.C., Chow, J.C.L., Cheng, Y., Ho, K.F., Fung, K., Liu, S.X. and Watson, J.G. (2005). Indoor/outdoor relationships for PM_{2.5} and associated carbonaceous pollutants at residential homes in Hong Kong - Case study. *Indoor Air* 15: 197–204.
- Chao, C.Y.H., Wan, M.P. and Cheng, E.C.K. (2003). Penetration coefficient and deposition rate as a function of particle size in non-smoking naturally ventilated residences. *Atmos. Environ.* 37: 4233–4241.
- Henschel, S., Atkinson, R., Zeka, A., Tertre, A.L., Analitis, A., Katsouyanni, K., Chanel, O., Pascal M., Forsberg, B., Medina, S. and Goodman, P.G. (2012). Air Pollution interventions and their impact on public health. *Int. J. Public Health* 57: 757–768.
- Hoek, G., Gerard, K., Harrison, R., Hartog, J., Meliefste, K., Brink, H., Katsouyanni, K., Karakatsani, A., Lianou, M., Kotronarou, A., Kavouras, I., Pekkanen, J., Vallius, M., Kulmala, M., Puustinen, A., Thomas, S., Meddings, C., Ayres, J., Wijnen, J. and Hameri, K. (2008). Indoor-outdoor relationships of particle number and mass in four European cities. *Atmos. Environ.* 42: 156–169.
- ISO (2015). *ISO 9972: Thermal Performance of Buildings – Determination of Air Permeability of Buildings- Fan Pressurization Method*. International Organization for Standardization.
- Jenkins, P.L., Phillips, T.J., Mulberg, E.J. and Hui, S.P. (1992). Activity patterns of Californians: Use of and proximity to indoor pollutant sources. *Atmos. Environ.* 26: 2141–2148.
- Kalamees, T., Kurnitski, J., Jokisalo, J., Eskola, L., Jokiranta, K. and Vinha, J. (2010). Measured and simulated air pressure conditions in Finnish residential

- buildings. *Build. Serv. Eng. Res. Technol.* 31: 177–190.
- KECO (2016). AirKorea, <http://www.airkorea.or.kr>. Korea Environment Corporation.
- Kim, B.G. and Park, S.U. (2001). Transport and evolution of a winter-time Yellow sand observed in Korea. *Atmos. Environ.* 35: 3191–3201.
- Kim, K.H. and Kim, M.Y. (2001). The Effects of Asian Dust on Particulate Matter Fractionation in Seoul, Korea During Spring 2001. *Chemosphere* 51: 707–721.
- Klepeis, N.E., Nelson, W.C., Ott, W.R., Robinson, J.P., Tsang, A.M., Switzer, P., Behar, J.V., Hem, S.C. and Engelmann, W.H. (2001). The National Human Activity Pattern Survey (NHAPS): A resource for assessing exposure to environmental pollutants. *J. Exposure Anal. Environ. Epidemiol.* 11: 231–252.
- Landis, M.S., Norris, G.A., Williams, R.W. and Weinstein, J.P. (2001). Personal exposures to PM_{2.5} mass and trace elements in Baltimore, MD, USA. *Atmos. Environ.* 35: 6511–6524.
- Lazaridis, M., Aleksandropoulou, V., Smolik, J., Hansen, J.E., Glytsos, T. and Kalogerakis, N. and Dahlin, E. (2006). Physico-chemical characterization of indoor/outdoor particulate matter in two residential houses in Oslo, Norway: Measurements overview and physical properties--URBAN-AEROSOL Project. *Indoor Air* 16: 282–295.
- Lee, H.S., Kang, B.W., Cheong, J.P. and Lee, S.K. (1997). Relationships between indoor and outdoor air quality during the summer season in Korea. *Atmos. Environ.* 31: 1689–1693.
- Lepeule, J., Laden, F., Dockery, D. and Schwartz, J. (2012). Chronic exposure to fine particles and mortality: an extended follow-up of the Harvard Six Cities study from 1974 to 2009. *Environ. Health Perspect.* 120: 965–970.
- Liu, D. and Nazaroff, W.W. (2003). Particle penetration through building cracks. *Aerosol Sci. Technol.* 37: 565–573.
- Long, C.M. and Sarnat, J.A. (2004). Indoor-outdoor relationships and infiltration behavior of elemental components of outdoor PM_{2.5} for Boston-area homes. *Aerosol Sci. Technol.* 38: 91–104.
- Lunden, M.M., Kirchstetter, T.W., Thatcher, T.L., Hering, S.V. and Brown, N.J. (2008). Factors affecting the indoor concentrations of carbonaceous aerosols of outdoor origin. *Atmos. Environ.* 42: 5660–5671.
- McCurdy, T., Glen, G., Smith, L. and Lakkadi, Y. (2000). The national exposure research laboratory's consolidated human activity database. *J. Exposure Anal. Environ. Epidemiol.* 10: 566–578.
- Meng, Q.Y., Turpin, B.J., Korn, L., Weisel, C.P., Morandi, M., Colome, S., Zhang, J.F.J., Stock, T., Spector, D., Winer, A., Zhang, L., Lee, J.H., Giovanetti, R., Cui, W., Kwon, J., Alimokhtari, S., Shendell, D., Jones, J., Farrar, C. and Maberti, S. (2005). Influence of ambient (outdoor) sources on residential indoor and personal PM_{2.5} concentrations: Analyses of RIOPA data. *J. Exposure Anal. Environ. Epidemiol.* 15: 17–28.
- Meng, Q.Y., Spector, D., Colome, S. and Turpin, B. (2009). Determinants of indoor and personal exposure to PM_{2.5} of indoor and outdoor origin during the RIOPA study. *Atmos. Environ.* 43: 5750–5758.
- Monn, C., Fuchs, A., Kogelschatz, D. and Wanner, H.U. (1995). Comparison of indoor and outdoor concentrations of PM₁₀ and PM_{2.5}. *J. Aerosol. Sci.* 26: 515–516.
- OECD (2015). OECD Better Life Index. <http://www.oecd-betterlifeindex.org>. Organisation for Economic Co-operation and Development.
- PHI (2007). *Passive House Planning Package 2007*. Passive House Institute.
- Pope III, C.A., Burnett, R.T., Thun, M.J., Calle, E.E., Krewski, D., Ito K., Thurston, G.D. (2002). Lung cancer, cardiopulmonary mortality, and long-term exposure to fine particulate air pollution *JAMA* 287: 1132–1141.
- Pope III, C.A., Ezzati, M. and Dockery, D.W. (2009). Fine-particulate air pollution and life expectancy in the United States. *N. Engl. J. Med.* 360: 376–386.
- Robinson, J. and Nelson, W.C. (1995). *National Human Activity Pattern Survey Data Base*. USEPA, Research Triangle Park, NC.
- Samoli, E., Peng, R., Ramsay, T., Pipikou, M. and Touloumi, G. (2008). Acute effects of ambient particulate matter on mortality in Europe and North America: Results from the APHENA study. *Environ. Health Perspect.* 116: 1480–1486.
- Sarnat, E.S., Coull, B.A., Ruiz, P.A., Koutrakis, P. and Suh, H.H. (2006). The influences of ambient particle composition and size on particle infiltration in Los Angeles, CA, residences. *J. Air Waste Manage. Assoc.* 56: 186–196.
- Schwerizer, C., Edwards, R., Bayer-Oglesby, L., Gauderman, W., Ilacqua, V., Jantunen, M., Lai, H.K., Nieuwenhuijsen, M. and Künzli, N. (2007). Indoor time-microenvironment-activity patterns in seven regions of Europe. *J. Exposure Sci. Environ. Epidemiol.* 17: 170–181.
- Stanek, L.W., Sacks, J.D., Dutton, S.J. and Dubois, J.J.B. (2011). Attributing health effects to apportioned components and sources of particulate matter: An evaluation of collective results. *Atmos. Environ.* 45: 5655–5663.
- Stone, E.A., Yoon, S.C. and Schauer, J.J. (2011). Chemical characterization of fine and coarse particles in Gosan, Korea during springtime dust events. *Aerosol Air Qual. Res.* 11: 31–43.
- Thatcher, T.L., Lunden, M.M., Revzan, K.L., Sextro, R.G. and Brown, N.J. (2003). A concentration rebound method for measuring particle penetration and deposition in the indoor environment. *Aerosol Sci. Technol.* 37: 847–864.
- USEPA (2012). *Particulate Matter (PM) Standards*. United States Environmental Protection Agency.
- USEPA (2013). *National Program Requirements - Energy STAR Certified Homes, Version 3*. United States Environmental Protection Agency.
- Van Erp A.M., Kelly, F.J., Demerjian, K.L., Pope III, C.A. and Cohen, A.J. (2012). Progress in research to assess the effectiveness of air quality interventions towards improving public health. *Air Qual. Atmos. Health* 5: 217–230.
- Wallace, L.A. and William, R. (2005). Use of personal-

- indoor-outdoor sulfur concentrations to estimate the infiltration factor and outdoor exposure factor for individual homes and persons. *Environ. Sci. Technol.* 39: 1707–1714.
- WHO (2006). *WHO Guidelines for Particulate Matter, Ozone, Nitrogen Dioxide and Sulfur Dioxide, Global Update 2005*. World Health Organization.
- WHO (2013). *Health Effects of Particulate Matter*. World Health Organization.
- Yun, D., Kim, M., Lee, J., Kim, B., Lee, D., Lee, S., Yu, S. and Kim, S. (2015). Correction factors for outdoor concentrations of PM_{2.5} measured with portable real-time monitors compared with gravimetric methods: Results from South Korea. *J. Environ. Sci. Int.* 24: 1559–1567.
- Zhu, Y., Hinds, W.C., Krudysz, M., Kuhn, T., Froines, J. and Sioutas, C. (2005). Penetration of freeway ultrafine particles into indoor environments. *J. Aerosol Sci.* 36: 303–322.

Received for review, June 30, 2016

Revised, September 27, 2016

Accepted, October 4, 2016